


Submittal Data: GTH(0	9,000 BTU/H Universal Floor/Ceiling Unit			
Job Name		Location	Date	
Purchaser		Engineer		
Submitted To		For Reference	Approval	Construction
Unit Designation		Schedule No.		
GENERAL FEATURES				
-Floor Stand or Ceiling Mount				=10
-Quiet Operation -Multi-Speed Fan -1-way Discharge Air Flow			an course	
-Swing Louvers		Hilli	W.	
-Wired and Wireless Remote Controllers	s	×	Gener	
-Unlimited 10 yr. Parts Warranty			Between	
-Without condensate pump		For these Section 1	BEN SE	
		10000 ¥ 100 m <sup>2</sup> 07		THE REAL PROPERTY.
System Ra	Physical Specifications			
Cooling*	3	,	'	
Rated Capacity	8,533 BTU/H	Unit Dimensions (LxHxD)		48.0 x 27.5 x 9.0 -ir
			1	1220 x 700 x 225-mn
Heating*	0 FF/ DTI//I	Majahk (Nak/Chinnina)		00/110   DO
Rated Capacity	9,556 BTU/H	Weight (Net/Shipping)		88/110 LBS
Sound Level (Hi/Lo)**		Drain Size (OD)		0.67-ir
Cooling	40/36 dbA	, ,		17-mm
Heating	40/36 dbA			
A'- Floor ()				
Air Flow (max) Indoor Fan	382 CFM			
IIIUUUI FaII	302 CFIVI			
Electrical R	Refrigerant Piping Data			
Fan Motor		Refrigerant Type		R410 <i>A</i>
Output Power	55 W	31		
FLA	0.28 A	Gas Pipe Size (OD)		3/8-ir
D 0 1				444
Power Supply Normal Operational Voltage	200/220 V 1 Dhana (0 V-	Liquid Pipe Size (OD)		1/4-ir
Normal Operational Voltage Voltage Range	208/230 V, 1 Phase, 60 Hz 187 - 253 V	Connection Method		Flared
MCA	107 - 253 V 1.0 A	CONTROCTION METHOD		rialec
Interconnecting Cable Wire Size	14-4 AWG			
		* Test conditions are based on AH	RI 210/240.	
		**Sound Power ratings are per AH		
	AHRI			

# **DIMENSIONAL SPECIFICATIONS**

# 9,000 BTUH MODEL





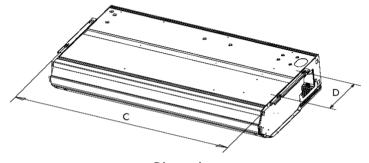

**Dimensions** 


(mm) (inches)


Α	В	С	D	Н	Н
1220	225	1158	280	700	700
48.0	8.9	45.6	11.0	27.6	27.6

Note: Size refrigerant lines based on evaporator port sizes.


# **MINIMUM CLEARANCE**

## ♦ Wall type






### Ceiling type







- 1. Recommended Interconnecting Cable Type Stranded Bare Copper Conductors THHN 600V Unshielded Wire
- 2. Power wiring cable size must comply with applicable national and local codes.
- 3. Test conditions are based on AHRI 210/240.

